


NOTES:

1. The M-Series Sensor will require a Bus Power Supply; max distance from the Bus Power Supply is 75' [22m].
2. The Bus Power Supply will require a Dedicated Outlet.
3. If exterior wire from Bus Power Supply is not in conduit, then outdoor rated wire must be used.
4. The M-Series Sensor should not be mounted where a shadow may be cast from surrounding environment.
5. Please refer to M-Series Sensor installation instructions to insure connections are properly insulated from the weather.

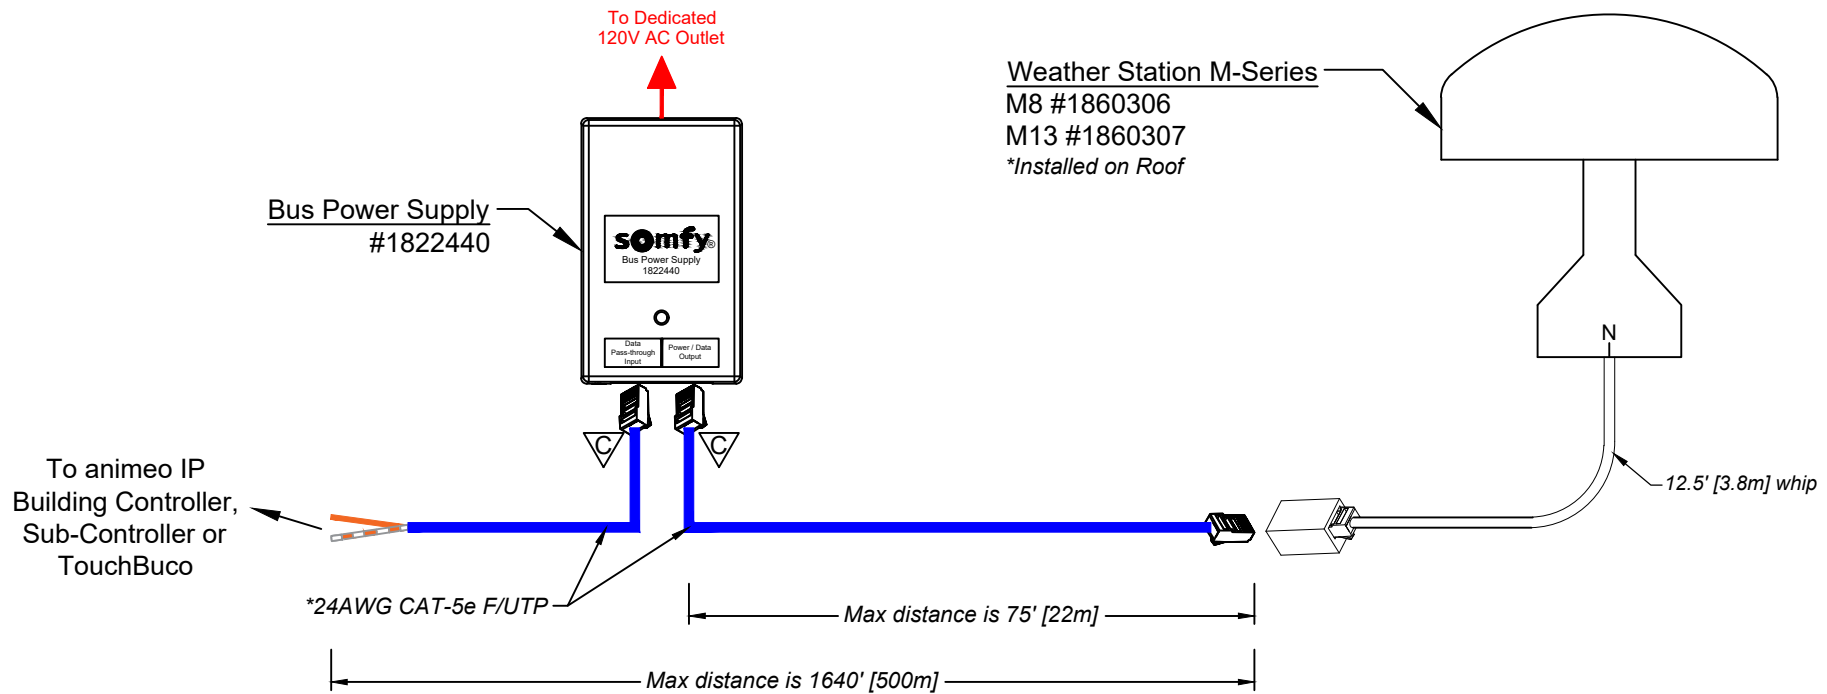

Date:	04/01/21	Revisions			
Print Size:	8.5" x 11"	Rev	Date	By	Description
Scale:	NTS	-	--/--	-	
Sales:	N/A	-	--/--	-	
Drawn by:	RV	-	--/--	-	
Checked by:	TS	-	--/--	-	

Dwg Title:	Weather Station M8/13 for animeo IP or animeo IB+ Wire Detail
Dwg No.:	WSM-WIRING-01

Project name:	Technical Library
Client:	Somfy Systems
Address:	121 Herrod Boulevard Dayton, NJ 08810